



1200
PSI

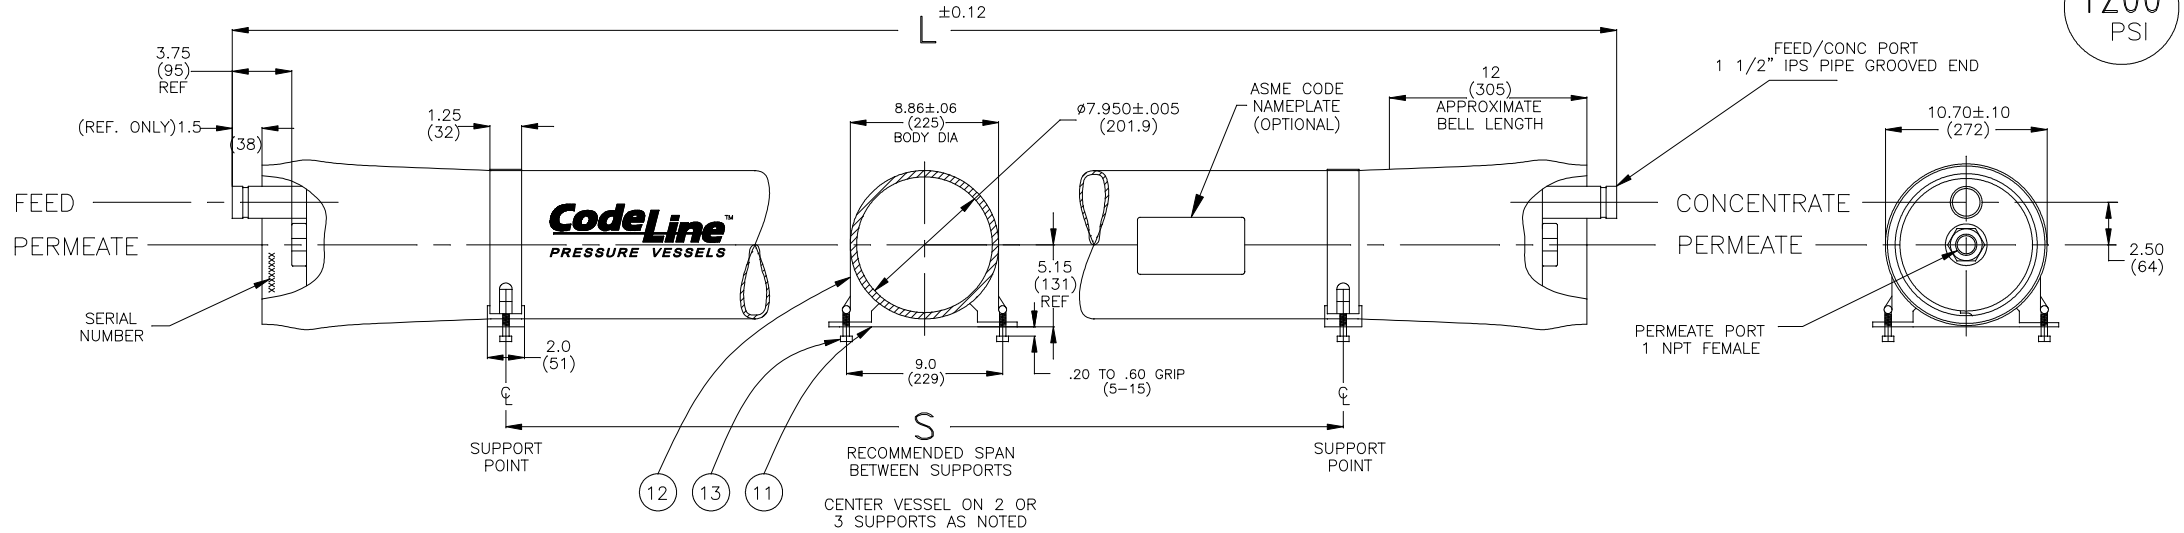

| DWG REF | QTY | PART NUMBER | DESCRIPTION | MATERIAL |
|--|-----|---------------|-------------------|--|
| SHELL | | | | |
| 01 | 1 | ORDER SECTION | SHELL | Filament Wound Epoxy/Glass composites - SS Head locking grooves integrally wound in place. |
| HEAD | | | | |
| 02 | 2 | 47293 | Bearing Plate | 6061-T6 Aluminium Alloy-Hard Anodized. |
| 03 | 2 | 96003 | Sealing Plate | Engineering Thermoplastic. |
| 04 | 2 | 50556 | Feed/Conc Port | Superaustenitic Stainless Steel, 6% Mo. |
| 05 | 2 | 45090 | Port Retainer Set | CF8M Cast SS, Two-piece set. |
| 06 | 2 | 50558 | Permeate Port | Engineering Thermoplastic. |
| 07 | 2 | 45066 | Port Nut | Engineering Thermoplastic. |
| 08 | 2 | 96000 | Head Seal | Ethylene Propylene - O Ring. (442) |
| 09 | 4 | 45312 | Port Seal | Ethylene Propylene - O Ring. (225) |
| HEAD INTERLOCK | | | | |
| 10 | 2 | 47336 | Retaining Ring | 316 Stainless Steel. |
| VESSEL SUPPORT | | | | |
| 11 | *2 | 52169 | Saddle | Engineering Thermoplastic. |
| 12 | *2 | 45042 | Strap Assy. | 304 Stainless Steel - PVC cushion |
| 13 | 4 | 46265 | Strap screw. | 5/16-18 UNC, 18-8 Stainless Steel. |
| ELEMENT INTERFACE | | | | |
| 14 | 2 | A/R | Adapter | Engineering Thermoplastic. |
| 15 | 4 | A/R | PWT Seal | Ethylene Propylene - O - Ring |
| 16 | 2 | 52245 | Adapter seal | Ethylene Propylene - O - Ring (124) |
| 17 | 1 | 45069 | Thrust Ring | Engineering Thermoplastic. |
| * 3 Each Furnished With Length Code 4, 5, 6 & 7. | | | | |

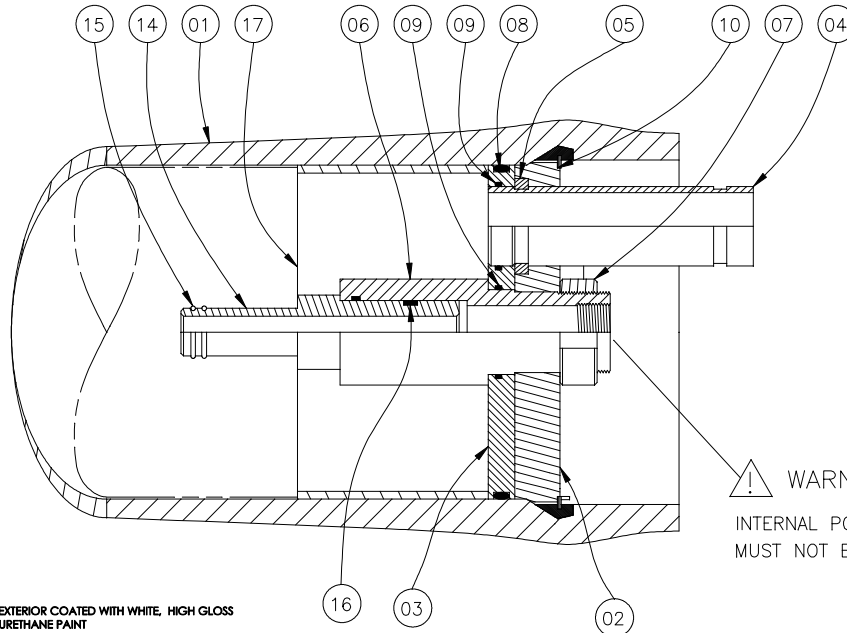

SECTION THROUGH END CLOSURE

ITEM 17 DOWNSTREAM ONLY

- NOTES
- *SHELL EXTERIOR COATED WITH WHITE, HIGH GLOSS POLYURETHANE PAINT
 - *DIMENSIONS ARE IN INCHES (MM APPROX.)
 - *NOT TO BE USED FOR CONSTRUCTION UNLESS CERTIFIED
 - *GENERAL TOLERANCES APPLY, FOR DETAILS CONTACT FACTORY
 - *L.O.A REFERS TO OVERALL LENGTH OF THE VESSEL
 - *EMPTY WEIGHT REFERS TO SHELL WEIGHT INCLUDING HEAD ASSEMBLIES WITHOUT MEMBRANES.

| Shell Length Code | L L.O.A. IN (MM) | S Span IN (MM) | Empty Weight LB (KG) |
|-------------------|------------------|----------------|----------------------|
| 1 | 65.125 (1651) | 35 X 1 (889) | 92 (42) |
| 2 | 105.125 (2670) | 75 X 1 (1905) | 132 (60) |
| 3 | 145.125 (3686) | 115 X 1 (2921) | 172 (78) |
| 4 | 185.125 (4702) | 77 X 2 (1956) | 212 (96) |
| 5 | 225.125 (5718) | 97 X 2 (2464) | 252 (114) |
| 6 | 265.125 (6734) | 117 X 2 (2972) | 292 (132) |
| 7 | 305.125 (7750) | 137 X 2 (3480) | 331 (150) |



| | | | | | |
|--------------|------------------|--------|------|--------|-----|
| ENGR IS | MODEL 80E120 | | | | |
| QTY HP | MEMBRANE HOUSING | | | | |
| DATE 10OCT06 | SCALE | SHEET | SIZE | NUMBER | REV |
| ECN : 978 | NONE | 1 OF 2 | B | 99110 | H |

RATING:

DESIGN PRESSURE.....1200 PSI at 120°F
 (8.27 Mpa @ 49°C)
 MIN.OPERATING TEMP.....20°F
 (-7°C)
 FACTORY TEST PRESSURE.....CE / ASME
 1800 / 1320 PSI
 (12.41Mpa) / (9.10 MPa)
 BURST PRESSURE.....7200 PSI
 (49.6 MPa)

INTENDED USE:

The CodeLine Model 80E120 Fiberglass RO Pressure Vessel is designed for continuous, long term use as a housing for reverse osmosis membrane elements to desalt typical sea waters at pressures up to 1200 psi. Any make of eight-inch nominal diameter spiral-wound element is easily accommodated; the appropriate interfacing hardware for the element specified is furnished with the vessel.

The CodeLine Model 80E120 is designed in accordance with the engineering standards of the Boiler and Pressure Vessel Code of the American Society of Mechanical Engineers (ASME Code). At small additional cost, vessels can be inspected during construction by an ASME Authorized Inspector and ASME Code stamped.

The CodeLine Model 80E120 must be installed, operated and maintained in accordance with the listed precautions and good industrial practice to assure safe operation over a long service life.

The high performance reinforced plastic shell must be allowed to expand under pressure; undue restraint at support points or piping connections can cause leaks to develop in the shell. The end closure, incorporating close fitting, interlocking metal components, must be kept dry and free of corrosion; deterioration can lead to catastrophic mechanical failure of the head.

The end closures, incorporating close-fitting, interlocking metal components, must be kept dry and free of corrosion; deterioration can lead to catastrophic mechanical failure of the heads.

Pentair Water will assist the purchaser in determining the suitability of this standard vessel for their specific operating conditions. The final determination however, including evaluation of the standard material of construction for compatibility with the specific corrosive environment, shall be the responsibility of the purchaser.

Specifications are subject to change without notice.

PRECAUTIONS:

DO...read, understand and follow all instructions; failure to take every precaution will void warranty and may result in vessel failure
 DO...mount the shell on horizontal members at span "S" using complaint vessel supports furnished; tighten hold down straps just snug
 DO...provide overpressure protection for vessel set at not more than 105% of design pressure
 DO...inspect end closures regularly; replace components that have deteriorated and correct causes of corrosion

DO NOT... make rigid piping connections to ports or clamp vessel in any way that resists growth of fiberglass shell under pressure; Δ DIA = 0.015 in. (0.4mm) and Δ L = 0.2 in. (5mm) for a length code -7 vessel
 DO NOT... hang piping manifolds from ports or use vessel in any way to support other components; branch connection piping may be simply supported between the header and port; maximum weight of branch piping; feed/concentrate – 16 lbs (7.3 kg); permeate – 8 lbs (3.6 kg)
 DO NOT... operate vessel at pressures and temperatures in excess of its rating
 DO NOT... operate vessel without permeate ports internally connected with a complete set of elements and interconnecting hardware
 DO NOT... operate vessel with permeate pressure in excess of 125 psi at 120°F (0.86 MPa @ 49°C)
 DO NOT... overtighten the connection to the permeate port (hand-tighten plus one-quarter turn, check for leaks)
 DO NOT... tolerate leaks or allow end closures to be routinely wetted in any way
 DO NOT... pressurize vessel until double-checking to verify that the retaining ring is completely inside the groove
 DO NOT... work on any component until first verifying that pressure is relieved from vessel
 DO NOT... operate at pH levels below 3 or above 10

ORDERING:

Using the chart below, please check the features you require and fax them with your purchase order to our customer service department for expedited processing.
 For optional materials and/or features not listed below, please consult factory for pricing and availability.

Please note that we require your membrane brand and model number when ordering. If this information is not initially available, you may provide it at a later date by checking the appropriate box below.

VESSEL LENGTH CODE – please check one

MODEL 80E120 -1 -2 -3 -4 -5 -6 -7

MEMBRANE BRAND AND MODEL – please check one and fill in information

Please supply adapters for the following membrane brand and specific model
 Brand _____ Model _____

CERTIFICATION REQUIRED

- ASME Stamped and National Board Registered (please consult factory for pricing)
- CE Marked
- Standard, Certified by Pentair water.

EXTERIOR FINISH – please check one

- Standard – white high-gloss polyurethane coating.
- Option – optional colors are available for 50 or more vessels per order. Call factory for pricing details.

MATERIAL OPTIONS

- Standard – All materials as per drawing 99110 on the first page.
- Customer specified materials: -
 (Please consult the factory, as these options will affect pricing and vessel lead-time.)

For complete information on proper use of this vessel please refer to the 80E series USER'S GUIDE Bulletin 523004.